


TMV UI

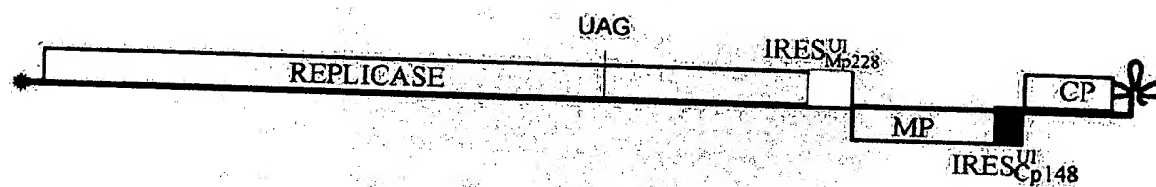

CrTMV


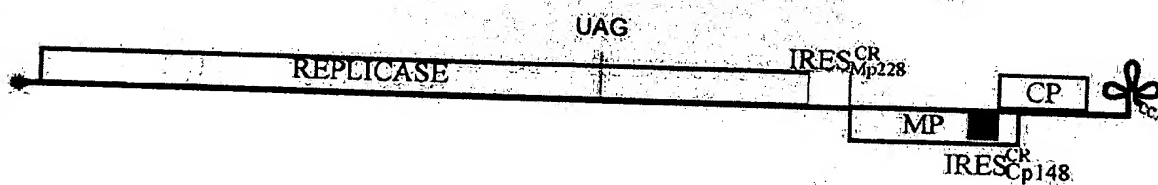


Fig.1A

0911733-072501

Fig. 1B

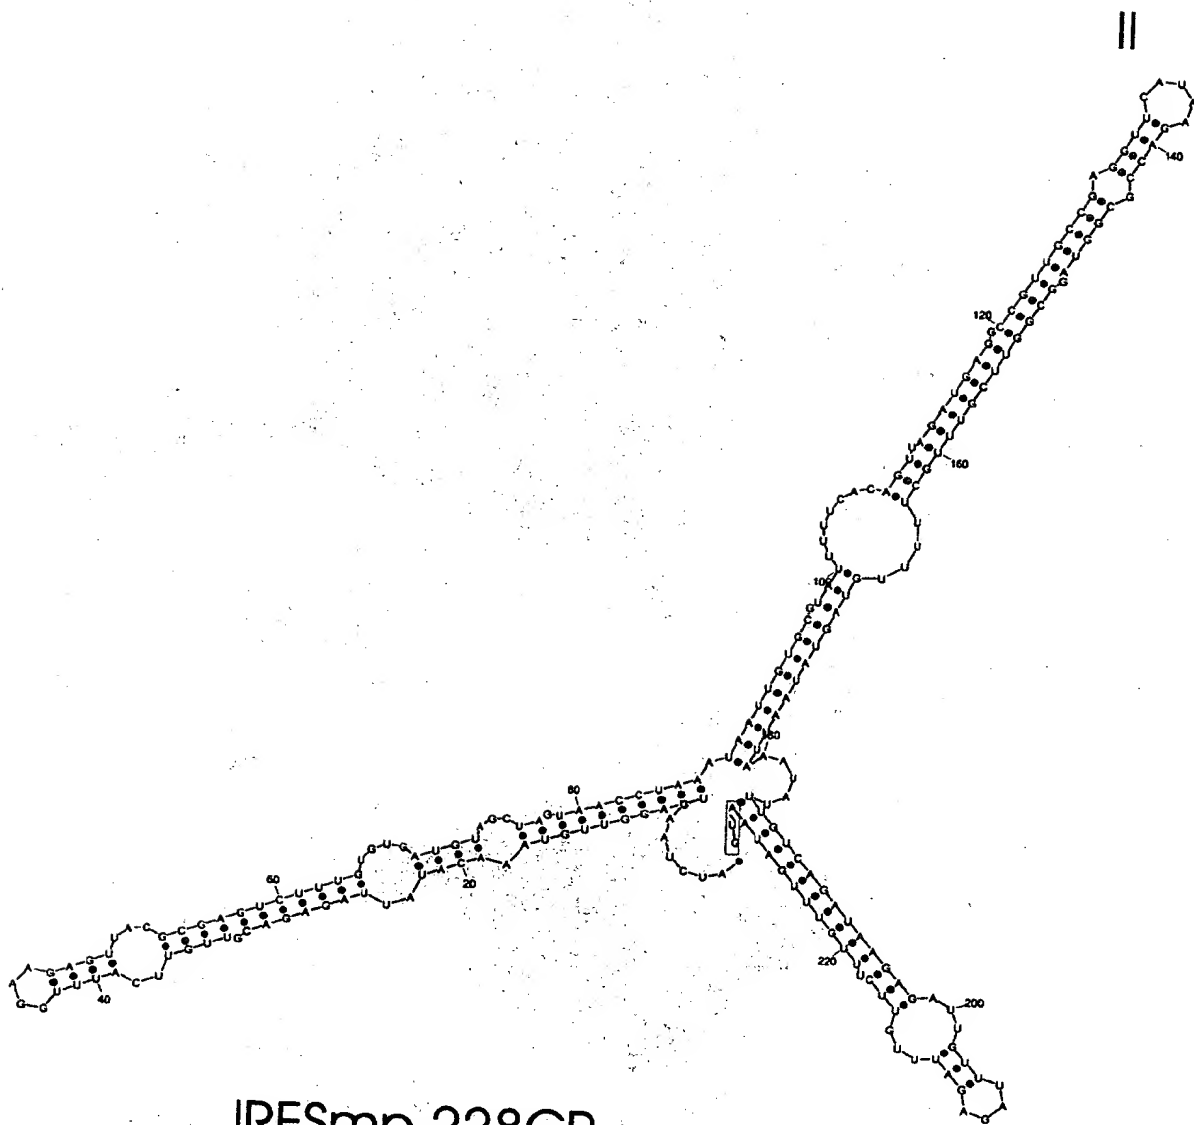


IRESmp,228CR

dG = -59.5 [initially -58.9] 01Jul13-05-49-46

09911732-072501

Fig. 1C

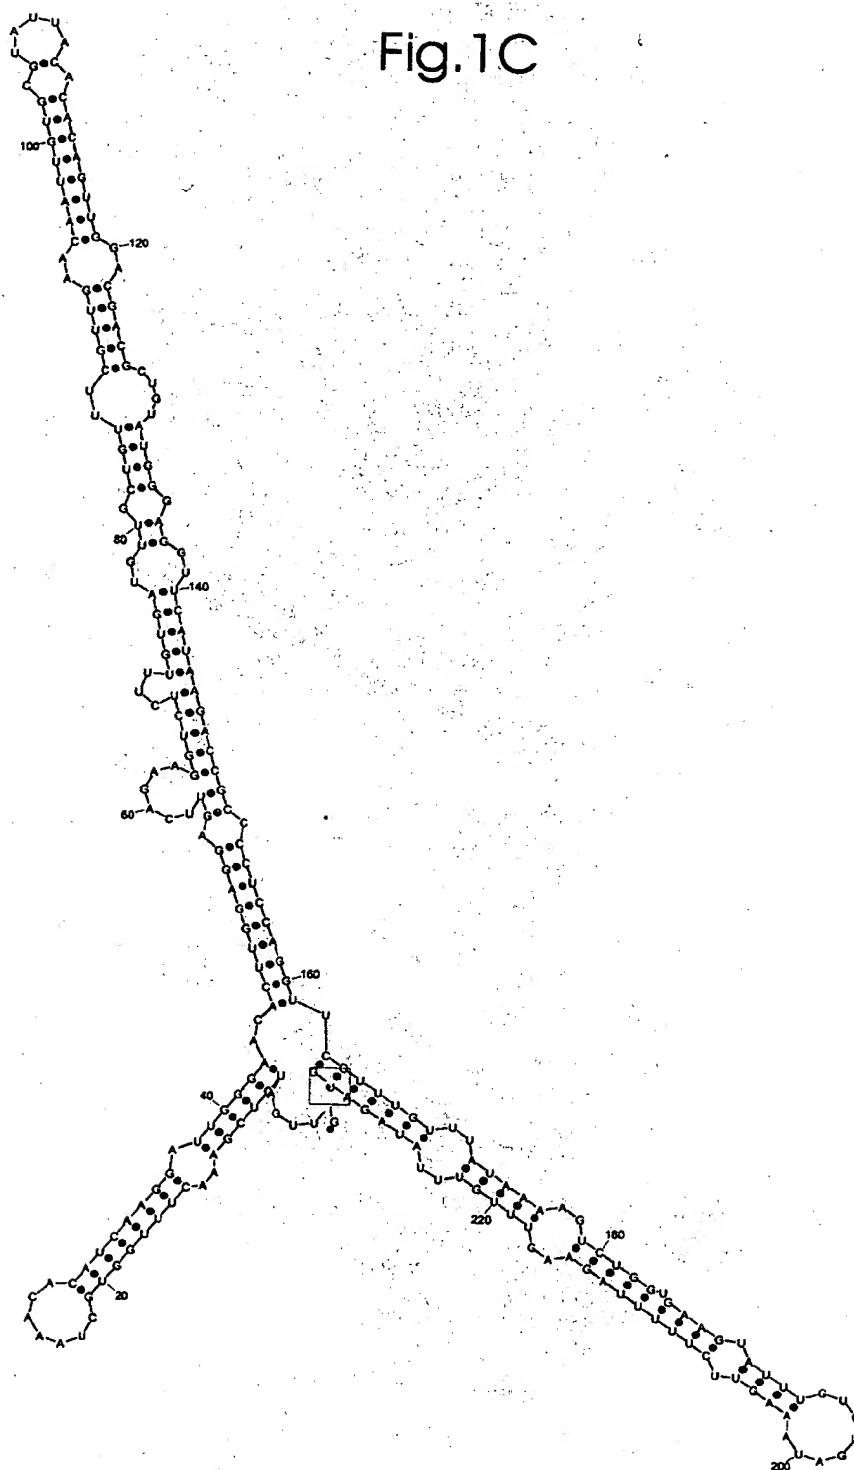

dG = -70 [initially -70.2] 01Jul13-06-19-02

IRESmp,228U

09911733.07501

105220-227TF660


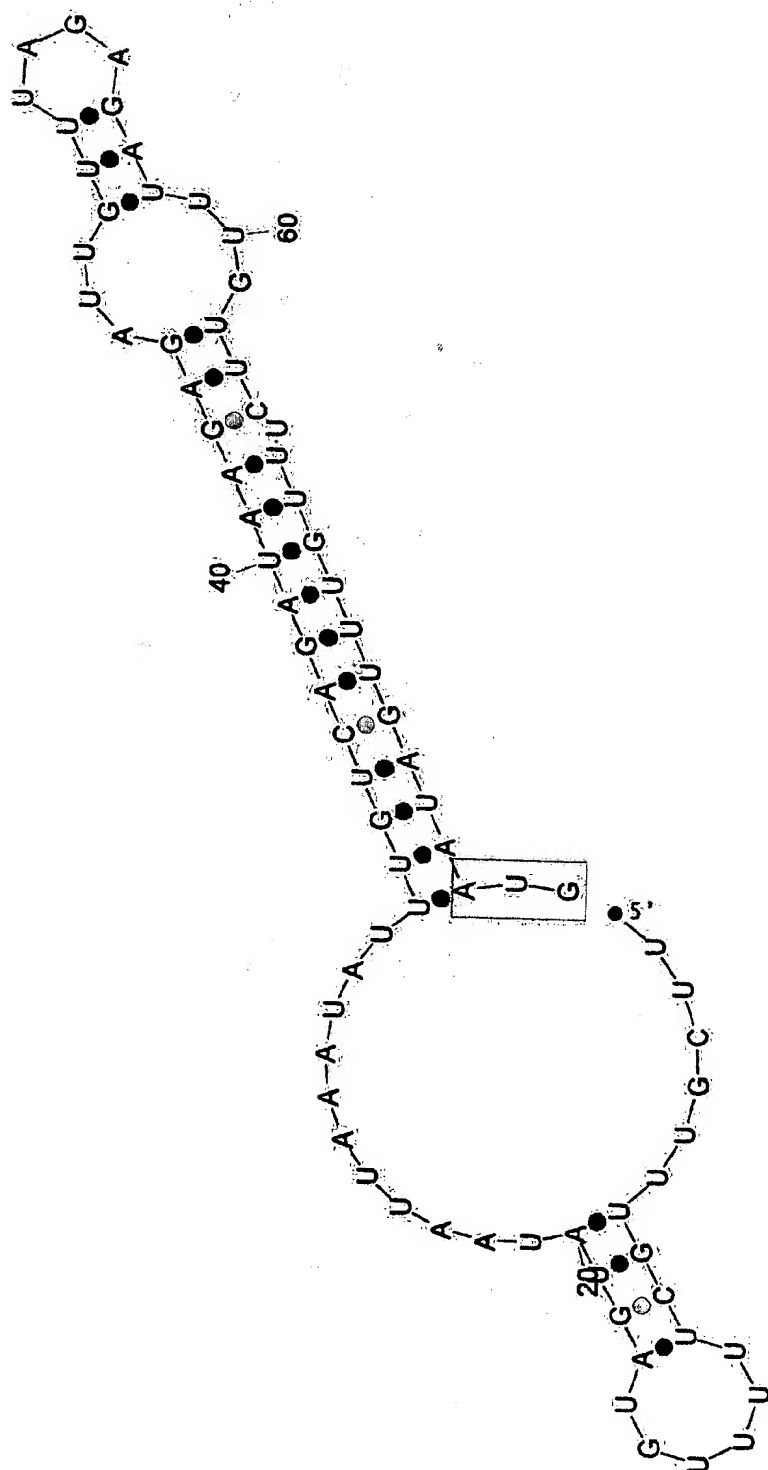


Fig. 1D

dG = -12 [initially -12.0] IRESmp75CR


Fig. 1E

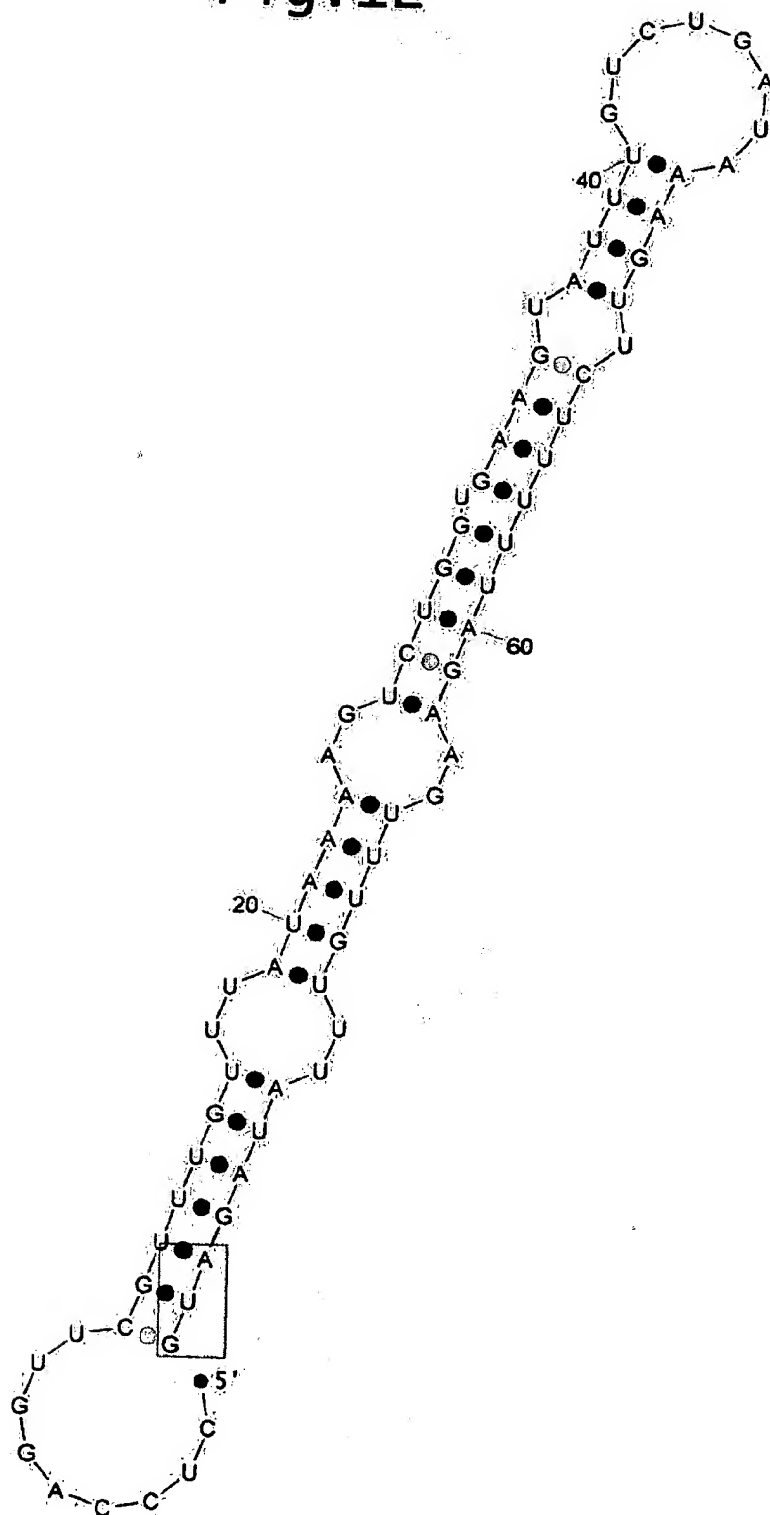

dG = -14.6 [initially -14.6] IRESmp75UL

105220*2E2T1660


Fig. 1F

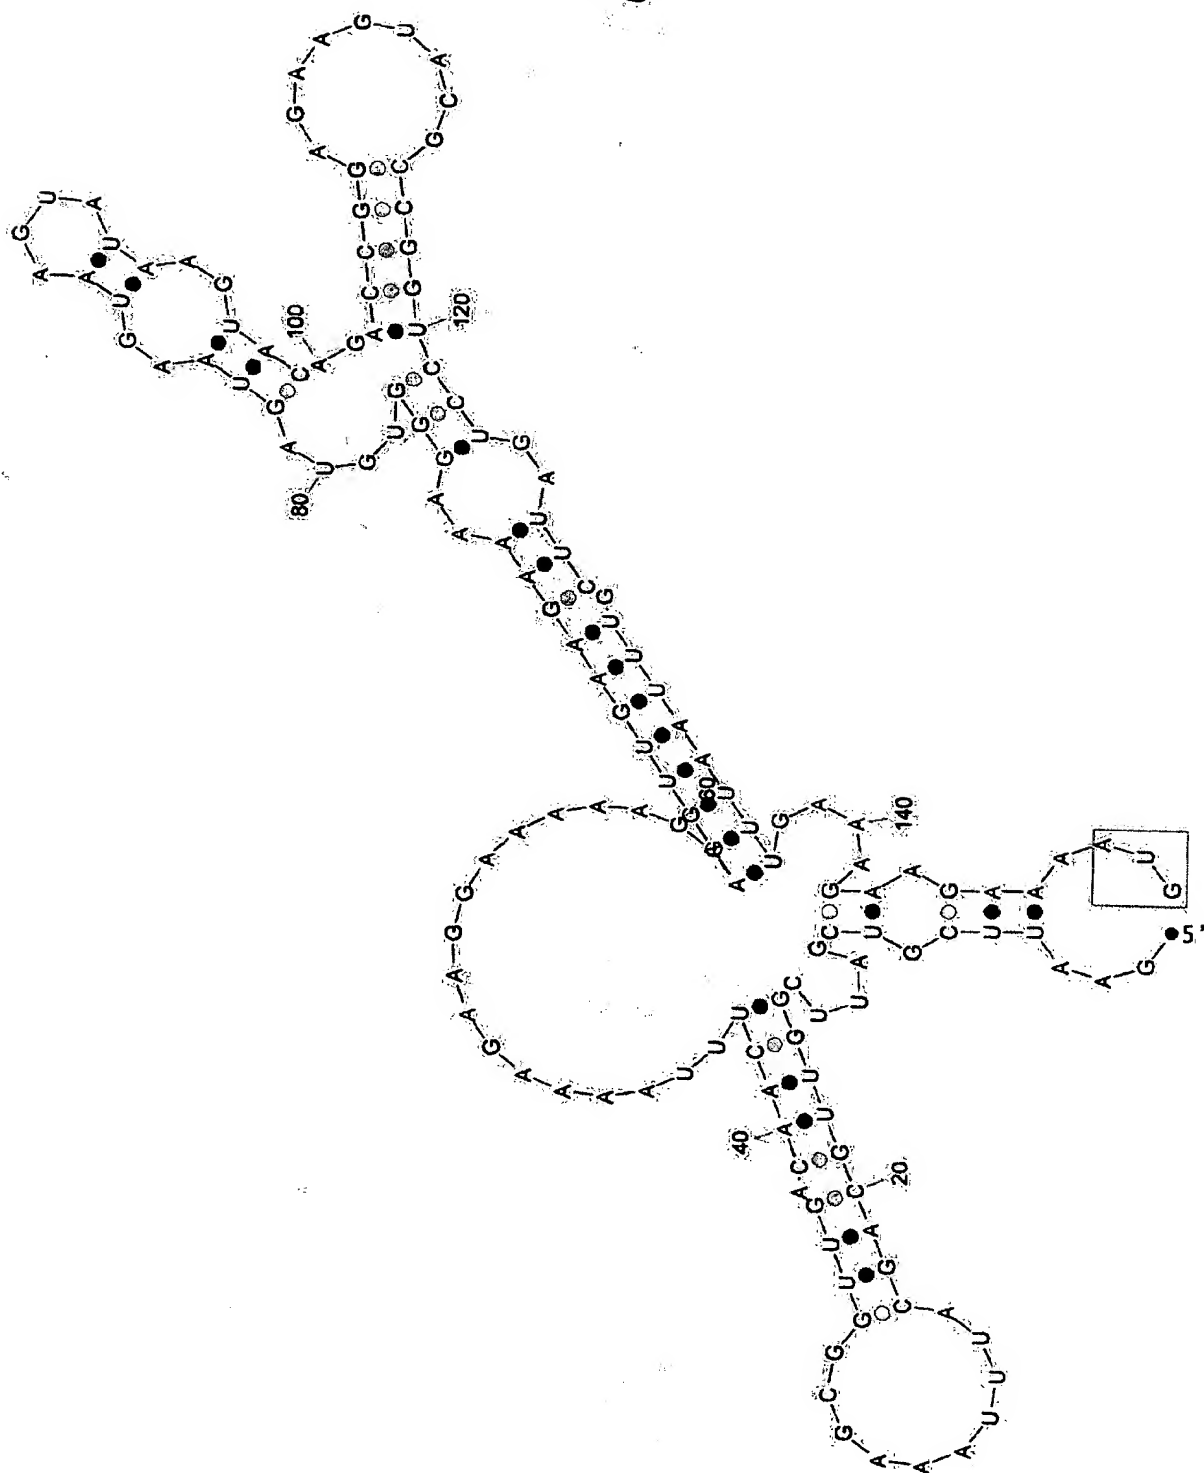

dG = -20.43 [Initially -24.9] IRES_{cp148CR}


FO5240-2E2FF660

Fig. 1G

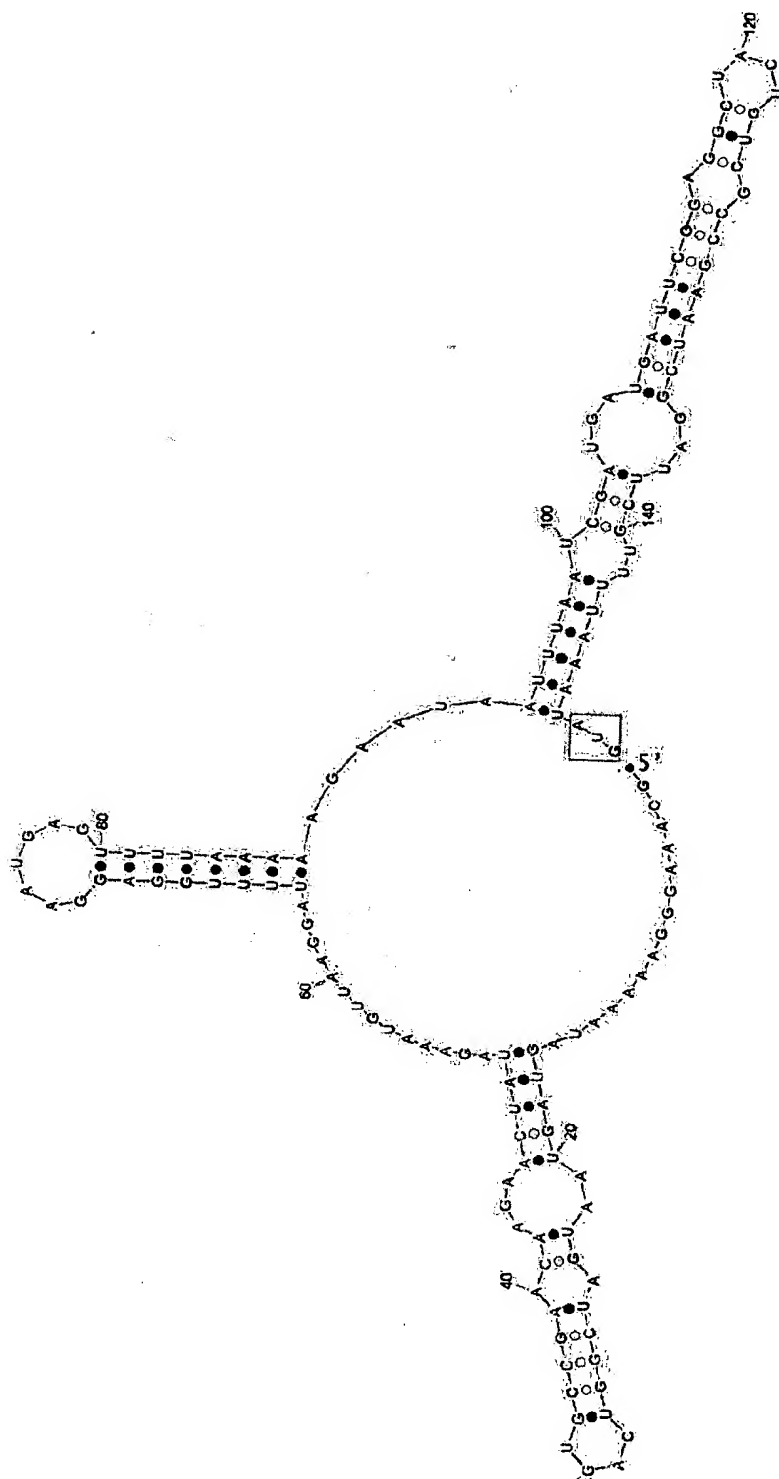

dG = -32.1 [initially -32.1] IREScp148U

Fig. 1H

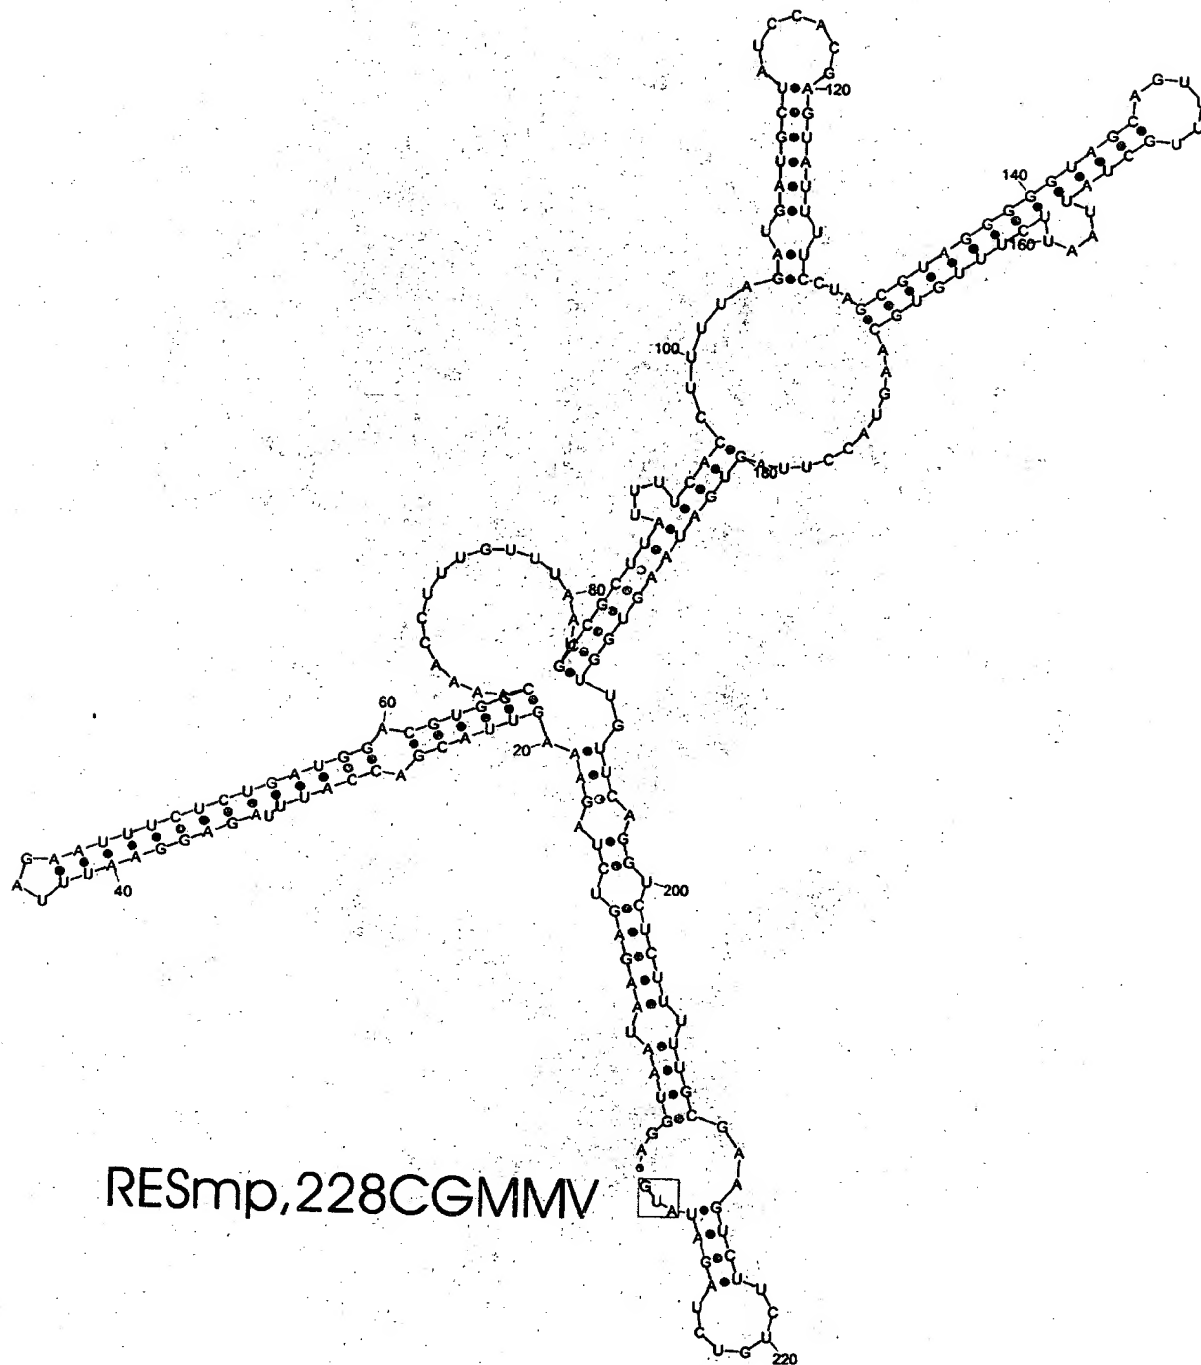

RESmp,228CGMMV

dG = -58.14 [initially -63.1] 01Jul13-06-30-00

090113 072501

091733-072501
105220 " 25/11/60

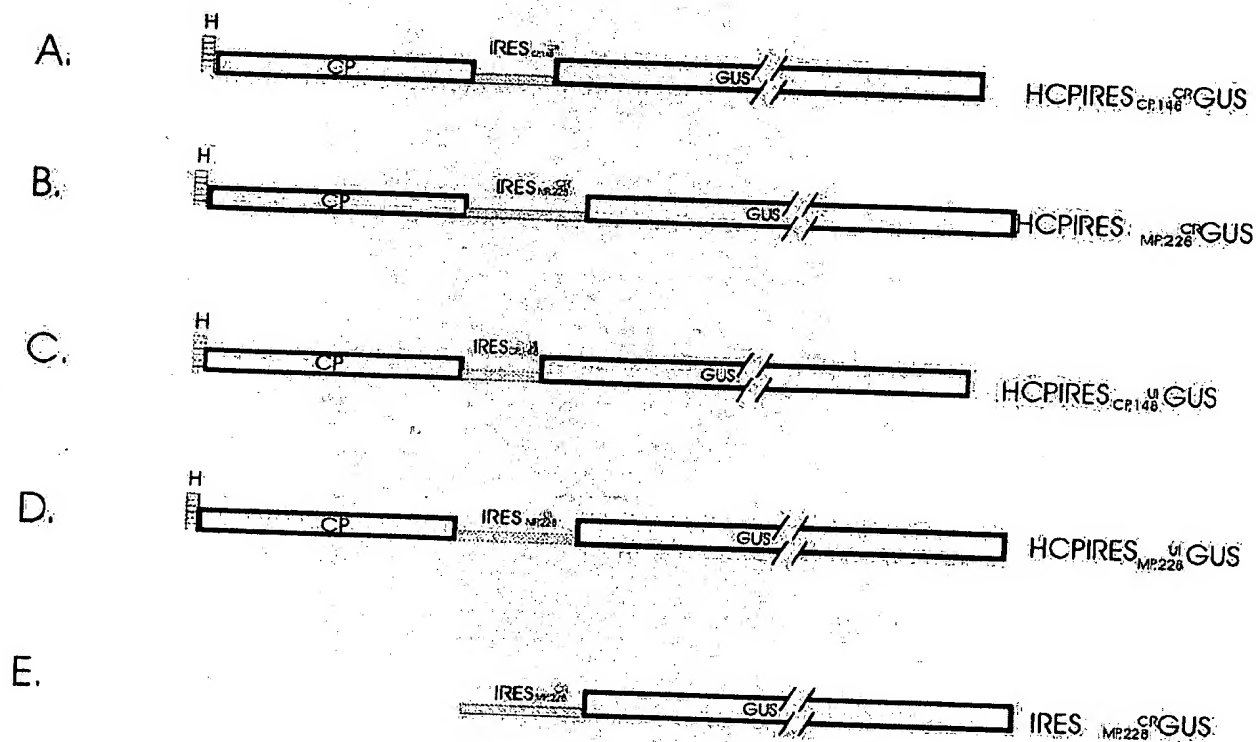


Fig.2

09911732.072501

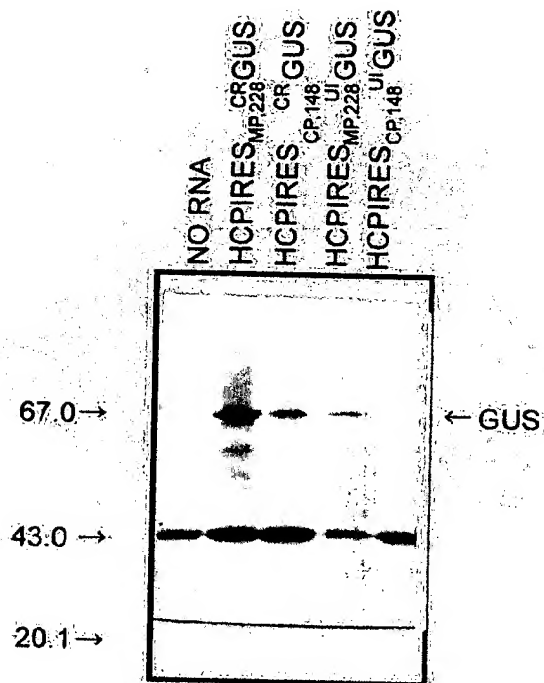


Fig.3A

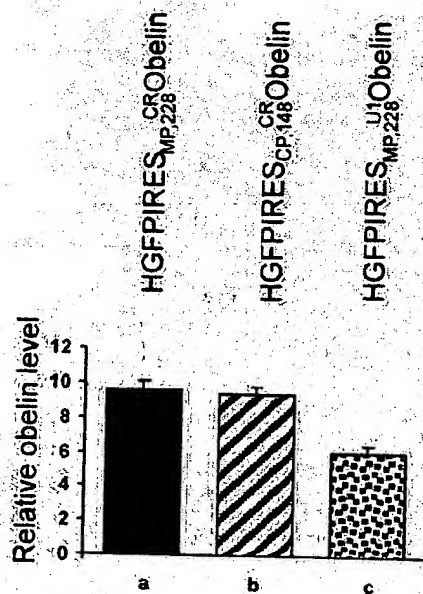


Fig.3B

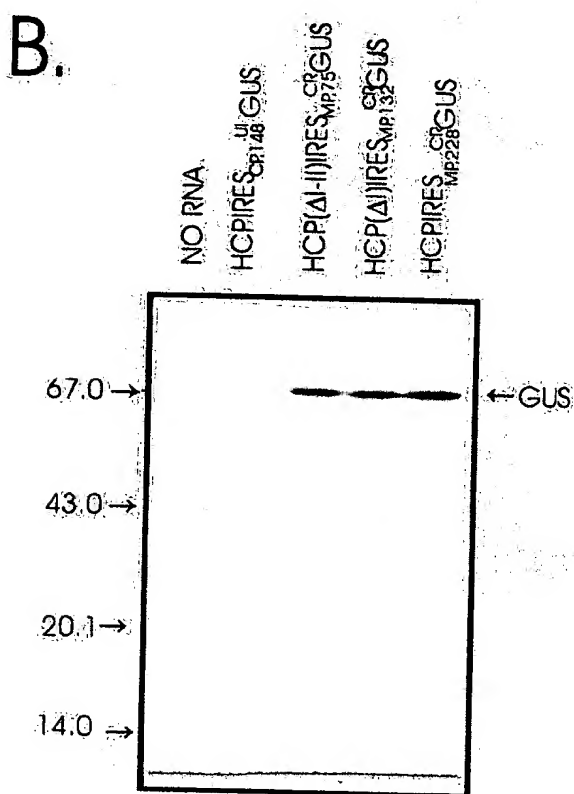
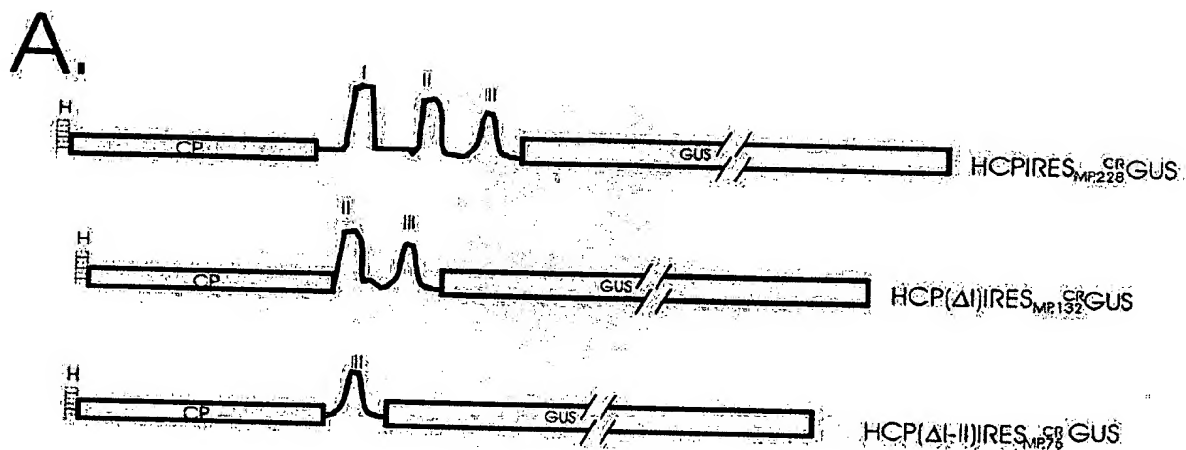


Fig.4

0991733.072501

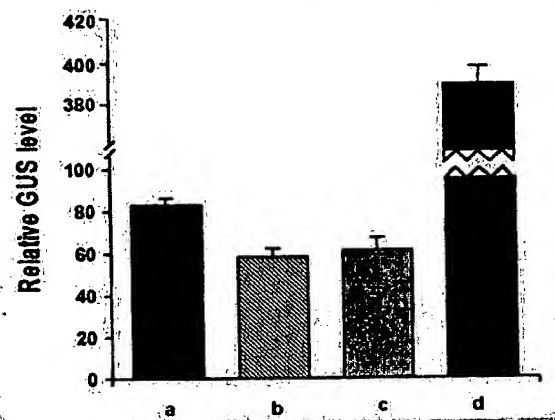


Fig.5